



# Standard Specification for Deformed and Plain Stainless-Steel Bars for Concrete Reinforcement<sup>1</sup>

This standard is issued under the fixed designation A955/A955M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope\*

1.1 This specification covers deformed and plain stainless-steel bars for concrete reinforcement used in applications requiring resistance to corrosion or controlled magnetic permeability. The standard sizes and dimensions of deformed bars and their numerical designation shall be those listed in Table 1. The text of this specification references notes and footnotes which provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the specification.

1.1.1 Supplementary requirement (S1) of an optional nature is provided. It shall apply only when specified by the purchaser. In order to obtain a controlled magnetic permeability product, steel conforming to Supplementary Requirement S1 should be ordered.

1.2 The chemical composition of the stainless steel alloy shall be selected for suitability to the application involved by agreement between the manufacturer and the purchaser. This is an important consideration in achieving the desired corrosion resistance or controlled magnetic permeability, or both, because these properties are not provided by all stainless steels.

NOTE 1—The alloys shown in Table 2 have found the most use in North America. Other alloys may also provide desired properties; consult with the manufacturer for stainless steel alloy properties and availability.

1.3 Bars are of three minimum yield strength levels, namely, 40 000 [280 MPa], 60 000 [420 MPa], and 75 000 psi [520 MPa], designated as Grade 40 [280], Grade 60 [420], and Grade 75 [520], respectively.

1.4 Plain rounds in sizes up to and including 2 in. [50.8 mm] in diameter, when specified for dowels, spirals, structural ties, and supports, shall be furnished under this specification in Grade 40 [280], Grade 60 [420], and Grade 75 [520], respectively. Bending properties, when required, shall be by agreement between the manufacturer and purchaser. Requirements providing for deformations and marking shall not be applicable to plain bars.

1.5 Weldability of most stainless steel compositions is generally good, however, pre-weld or post-weld procedures, or both, are necessary. Where material is to be welded, a welding procedure suitable for the chemical composition and intended use or service shall be used. Retesting of physical properties should be considered following welding procedures depending upon the steel composition and welding operation involved.

NOTE 2—It is recommended that the user consult the manufacturer for information available from the Nickel Development Institute (NIDI) (Toronto, Canada).

1.6 This specification is applicable for orders in either inch-pound units (as Specification A955) or in SI units (as Specification A955M).

1.7 The values stated in either inch-pound or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance with the standard.

1.8 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

### 2.1 ASTM Standards:<sup>2</sup>

- A6/A6M Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling
- A276 Specification for Stainless Steel Bars and Shapes
- A342/A342M Test Methods for Permeability of Feebly Magnetic Materials
- A370 Test Methods and Definitions for Mechanical Testing of Steel Products
- A484/A484M Specification for General Requirements for Stainless Steel Bars, Billets, and Forgings
- A510 Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel

<sup>1</sup> This specification is under the jurisdiction of ASTM Committee A01 on Steel, Stainless Steel and Related Alloys and is the direct responsibility of Subcommittee A01.05 on Steel Reinforcement.

Current edition approved Oct. 1, 2009. Published November 2009. Originally approved in 1996. Last previous edition approved in 2009 as A995/A995M – 09. DOI: 10.1520/A0955\_A0955M-09A.

<sup>2</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

\*A Summary of Changes section appears at the end of this standard.

**TABLE 1 Deformed Bar Designation Numbers, Nominal Weights [Masses], Nominal Dimensions, and Deformation Requirements**

Bar Designation No.	Nominal Weight, lb/ft [Nominal Mass, kg/m] <sup>A</sup>		Nominal Dimensions <sup>B</sup>			Deformation Requirements, in. [mm]		
	400 Series; Duplex Alloys	300 Series	Diameter, in. [mm]	Cross-Sectional Area, in. <sup>2</sup> [mm <sup>2</sup> ]	Perimeter, in. [mm]	Maximum Average Spacing	Minimum Average Height	Maximum Gap (Chord of 12.5 % of Nominal Perimeter)
3 [10]	0.374 [0.556]	0.378 [0.562]	0.375 [9.5]	0.11 [71]	1.178 [29.9]	0.262 [6.7]	0.015 [0.38]	0.143 [3.6]
4 [13]	0.679 [1.011]	0.686 [1.021]	0.500 [12.7]	0.20 [129]	1.571 [39.9]	0.350 [8.9]	0.020 [0.51]	0.191 [4.9]
5 [16]	1.048 [1.559]	1.058 [1.575]	0.625 [15.9]	0.31 [199]	1.963 [49.9]	0.437 [11.1]	0.028 [0.71]	0.239 [6.1]
6 [19]	1.495 [2.225]	1.511 [2.248]	0.750 [19.1]	0.44 [284]	2.356 [59.8]	0.525 [13.3]	0.038 [0.97]	0.286 [7.3]
7 [22]	2.038 [3.032]	2.059 [3.064]	0.875 [22.2]	0.60 [367]	2.749 [69.8]	0.612 [15.5]	0.044 [1.12]	0.334 [8.5]
8 [25]	2.685 [3.995]	2.713 [4.037]	1.000 [25.4]	0.79 [510]	3.142 [79.8]	0.700 [17.8]	0.050 [1.27]	0.383 [9.7]
9 [29]	3.396 [5.053]	3.441 [5.106]	1.128 [28.7]	1.00 [645]	3.544 [90.0]	0.790 [20.1]	0.056 [1.42]	0.431 [10.9]
10 [32]	4.312 [6.416]	4.358 [6.484]	1.270 [32.3]	1.27 [819]	3.990 [101.3]	0.889 [22.6]	0.064 [1.63]	0.487 [12.4]
11 [36]	5.296 [7.880]	5.352 [7.964]	1.410 [35.8]	1.56 [1006]	4.430 [112.5]	0.987 [25.1]	0.071 [1.80]	0.540 [13.7]
14 [43]	7.64 [11.37]	7.72 [11.49]	1.693 [43.0]	2.25 [1452]	5.32 [135.1]	1.185 [30.1]	0.085 [2.16]	0.648 [16.5]
18 [57]	13.59 [20.22]	13.72 [20.43]	2.257 [57.3]	4.00 [2581]	7.09 [180.1]	1.58 [40.1]	0.102 [2.58]	0.864 [21.9]

<sup>A</sup> The 400 and Duplex-Alloy Series is based on a density of 489.59 lb/in.<sup>3</sup> [7833.4 kg/m<sup>3</sup>]. The 300 Series is based on a density of 494.78 lb/ft<sup>3</sup> [7916.5 kg/m<sup>3</sup>]. Density varies with alloy content which may result in a variation of several percent.

<sup>B</sup> The nominal dimensions of a deformed bar are equivalent to those of a round bar having the same weight [mass] per foot [metre] as the deformed bar.

**TABLE 2 Chemical Requirements of Typical Alloys<sup>A</sup>**

UNS Designation	Type	Composition %								
		Carbon	Manganese	Phosphorus	Sulfur	Silicon	Chromium	Nickel	Molybdenum	Nitrogen
S24000	XM-29	0.08	11.50-	0.060	0.030	1.00	17.00-	2.25-	....	0.20-
			14.50				19.00	3.75		
S24100	XM-28	0.15	11.00-	0.060	0.030	1.00	16.50-	0.50-	....	0.20-
			14.00				19.00	2.50		
S30400	304	0.08	2.00	0.045	0.030	1.00	18.00-	8.00-	....	0.10
S31603	316L	0.03	2.00	0.045	0.030	1.00	16.00-	10.00-	2.00-3.00	0.10
							18.00	14.00		
S31653	316LN	0.03 max	2.00	0.045	0.030	1.00	16.00-	10.00-	2.00-3.00	0.10-
							18.00	14.00		
S31803	....	0.03	2.00	0.030	0.020	1.00	21.00-	4.50-	2.50-3.50	0.08-
							23.00	6.50		

<sup>A</sup> Maximum, unless otherwise indicated.

A510M Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel (Metric)  
A700 Practices for Packaging, Marking, and Loading Methods for Steel Products for Shipment  
A751 Test Methods, Practices, and Terminology for Chemical Analysis of Steel Products  
C192/C192M Practice for Making and Curing Concrete Test Specimens in the Laboratory  
E29 Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications  
G15 Terminology Relating to Corrosion and Corrosion Testing  
2.2 U.S. Military Standard:<sup>3</sup>  
MIL-STD-129 Marking for Shipment and Storage  
2.3 U.S. Federal Standard:<sup>3</sup>  
Fed. Std. No. 123 Marking for Shipment (Civil Agencies)

### 3. Terminology

#### 3.1 Definitions of Terms Specific to This Standard:

3.1.1 *deformations, n*—transverse protrusions on a deformed bar.

3.1.2 *deformed bar, n*—steel bar with protrusions; a bar that is intended for use as reinforcement in reinforced concrete construction.

3.1.2.1 *Discussion*—The surface of the bar is provided with lugs or protrusions that inhibit longitudinal movement of the bar relative to the concrete surrounding the bar in such construction. The lugs or protrusions conform to the provisions of this specification.

3.1.3 *plain bar, n*—steel bar without protrusions.

3.1.4 *rib, n*—longitudinal protrusion on a deformed bar.

3.1.5 *stainless steel, n*—a steel that contains 11 % or more chromium.

### 4. Ordering Information

4.1 It shall be the responsibility of the purchaser to specify all requirements that are necessary for material ordered to this specification. Such requirements shall include but are not limited to the following:

- 4.1.1 Quantity (weight) [mass],
- 4.1.2 Name of material (deformed and plain stainless steel bars for concrete reinforcement),
- 4.1.3 Chemical composition (stainless steel alloy),
- 4.1.4 Heat treatment condition,
- 4.1.5 Size,
- 4.1.6 Length,

<sup>3</sup> Available from Standardization Documents Order Desk, DODSSP, Bldg. 4, Section D, 700 Robbins Ave., Philadelphia, PA 19111-5098, <http://www.dodssp.daps.mil>.

- 4.1.7 Deformed or plain,
- 4.1.8 Grade (strength level),
- 4.1.9 Descaling method and finish,
- 4.1.10 Packaging (see Section 24),
- 4.1.11 Supplementary requirement (if desired), and
- 4.1.12 ASTM designation and year of issue.

**5. Materials and Manufacture**

- 5.1 The bars shall be rolled from properly identified heats of mold or strand cast steel.
- 5.2 Bars shall be furnished in one of the following heat treatment conditions, as shown in Specification A276, and as needed to meet the requirements of this specification.
  - 5.2.1 Annealed (A).
  - 5.2.2 Hot rolled (HR).
  - 5.2.3 Strain hardened (B).

NOTE 3—The mechanical properties of the material result from the heat treat condition of the material. Any further heat treatment of the material may alter those properties and affect their ability to meet the specified strength level. No re-treatment should be imposed without retesting to the requirements of this specification.

**6. Chemical Composition**

- 6.1 The chemical analysis of each heat of steel shall be determined in accordance with Test Methods, Practices, and Terminology A751. The manufacturer shall make the analysis on test samples taken preferably during the pouring of the heat. Such analysis shall meet the chemical composition requirements specified in Table 2 by the purchaser.
- 6.2 When specified by the purchaser, an analysis of the product shall be made by the manufacturer and shall conform to the analysis tolerances specified in Table 1 of Specification A484/A484M.
- 6.3 An analysis made by the purchaser from the finished product shall meet the specification tolerances of Specification A484/A484M.

**7. Requirements for Deformations**

- 7.1 Deformations shall be spaced along the bar at substantially uniform distances. The deformations on opposite sides of the bar shall be similar in size, shape, and pattern.
- 7.2 The deformations shall be placed with respect to the axis of the bar so that the included angle is not less than 45°. Where the line of deformations forms an included angle with the axis of the bar of from 45 to 70° inclusive, the deformations shall alternately reverse in direction on each side or those on one side shall be reversed in direction from those on the opposite side. Where the line of deformation is over 70°, a reversal in direction is not required.
- 7.3 The average spacing or distance between deformations on each side of the bar shall not exceed seven tenths of the nominal diameter of the bar.
- 7.4 The overall length of deformations shall be such that the gap (measured as a chord) between the ends of the deformations shall not exceed 12½ % of the nominal perimeter of the bar. Where the ends terminate in a rib, the width of the rib shall be considered as the gap between these ends. The summation of the gaps shall not exceed 25 % of the nominal perimeter of the bar. Furthermore, the summation of gaps shall not exceed

25 % of the nominal perimeter of the bar. The nominal perimeter of the bar shall be 3.1416 times the nominal diameter.

7.5 The spacing, height, and gap of deformations shall conform to the requirements prescribed in Table 1.

**8. Measurement of Deformations**

- 8.1 The average spacing of deformations shall be determined by measuring the length of a minimum of ten spaces and dividing that length by the number of spaces included in the measurement. The measurement shall begin from a point on a deformation at the beginning of the first space to a corresponding point on a deformation after the last included space. Spacing measurements shall not be made over a bar area containing bar marking symbols.
- 8.2 The average height of deformations shall be determined from measurements made on not less than two typical deformations. Determinations shall be based on three measurements per deformation, one at the center of the overall length and the other two at the quarter points of the overall length.
- 8.3 Insufficient height, insufficient circumferential coverage, or excessive spacing of deformations shall not constitute cause for rejection unless it has been clearly established by determinations on each lot (Note 4) tested that typical deformation height, gap, or spacing does not conform to the minimum requirements prescribed in Section 7. No rejection shall be made on the basis of measurements if fewer than ten adjacent deformations on each side of the bar are measured.

NOTE 4—A lot, for this purpose, is defined as all the bars of one bar number and pattern of deformation contained in an individual shipping release or shipping order.

**9. Tensile Requirements**

- 9.1 The material, as represented by the test specimens, shall conform to the requirements for tensile properties prescribed in Table 3 or by agreement between the manufacturer and the purchaser.
- 9.2 The yield strength shall be determined by the offset method (0.2 % offset), as described in Test Methods and Definitions A370 (paragraph 13.2.1).
- 9.3 The percentage of elongation shall be as prescribed in Table 3. When the actual percentage of elongation meets or exceeds 25 % of the bending requirements in Section 10 shall be waived.

**TABLE 3 Tensile Requirements**

NOTE 1—Check with producer for availability of grades and sizes.

	Grade 40 [280]	Grade 60 [420]	Grade 75 [520]
Tensile strength, min, psi [MPa]	70 000 [500]	90 000 [620]	100 000 [690]
Yield strength, min, psi [MPa]	40 000 [280]	60 000 [420]	75 000 [520]
Elongation in 8 in. [200 mm], min, %			
Bar designation no.			
3, 4, 5 [10, 13, 16]	20	20	
6 [19]	20	20	20
7, 8, 9, 10, 11, 14, 18 [22, 25, 29, 32, 36, 43, 57]		20	20

## 10. Bending Requirements

10.1 The bend test specimen shall withstand being bent around a pin without cracking on the outside radius of the bent portion. The requirements for degree of bending and sizes of pins are prescribed in Table 4.

10.2 The bend test shall be made on specimens of sufficient length to ensure free bending and with apparatus which provides the following:

10.2.1 Continuous and uniform application of force throughout the duration of the bending operation,

10.2.2 Unrestricted movement of the specimen at points of contact with the apparatus and bending around a pin free to rotate, and

10.2.3 Close wrapping of the specimen around the pin during the bending operation.

10.3 It is permissible to use more severe methods of bend testing, such as placing a specimen across two pins free to rotate and applying the bending force with a fixed pin. When failures occur under more severe methods, retests shall be permitted under the bend-test method prescribed in 10.2.

## 11. Hardness Requirements

11.1 Martensitic grades shall meet the minimum hardness requirements shown in Specification A276, or other referenced specifications.

## 12. Corrosion Resistance Requirements

12.1 The demonstration of corrosion resistance shall be by the recommended practice in Annex A1 or by agreement between the manufacturer and the purchaser.

12.2 Corrosion performance as demonstrated in Annex A1 shall be performed one time for each stainless steel alloy processed as reinforcement by each manufacturer. Corrosion performance for the alloy shall be redemonstrated if the processing method is significantly altered.

## 13. Magnetic Properties

13.1 Controlled magnetic permeability shall be specified by invoking Supplementary Requirement S1.

## 14. Permissible Variation in Weight [Mass]

14.1 Deformed reinforcing bars shall be evaluated on the basis of nominal weight [mass]. The weight [mass] determined using the measured weight [mass] of the test specimen and rounding in accordance with Practice E29, shall be at least 94 % of the applicable weight [mass] per unit prescribed in

Table 1. In no case shall overweight [excess mass] of any deformed bar be the cause for rejection. Weight [mass] variation for plain rounds shall be computed on the basis of permissible variation in diameter. For plain rounds smaller than  $\frac{3}{8}$  in. [9.5 mm], use Specification A510 [Specification A510M]. For larger bars up to and including 2 in. [50.8 mm], use Specification A6/A6M.

14.2 The specified limit of variation shall be evaluated in accordance with Practice E29 (rounding method).

## 15. Finish

15.1 The bars shall be free of detrimental surface imperfections.

15.2 Seams, surface irregularities, or mill oxidation shall not be cause for rejection, provided the mass, dimensions, cross-sectional area, and tensile properties of a test specimen are not less than the requirements of this specification.

15.3 Surface imperfections other than those specified in 15.1 shall be considered detrimental when specimens containing such imperfections fail to conform to either tensile or bending requirements.

15.4 Unless otherwise specified by the purchaser, after rolling, the bars shall be pickled to remove mill scale and surface oxidation.

NOTE 5—Pickling has been shown to be needed for the corrosion resistance of most stainless steel reinforcement.

## 16. Number of Tests

16.1 For all bar sizes, one tension test, one bend test, if required (see 6.3), and one set of dimensional property tests including bar weight [mass] and spacing, height, and gap of deformations shall be made of each bar size rolled from each heat and of the same heat treatment condition.

16.2 For martensitic material, two hardness tests shall be taken per lot of material. A manufacturing lot is defined as material from one heat of material heat treated in one furnace at one time. For continuous furnaces used for tempering or aging, a manufacturing lot is defined as material from one heat of material heat treated in one continuous run but not to exceed 10 000 lbs [4500 kg].

## 17. Retests

17.1 If the results of an original tension specimen fail to meet the specified minimum requirements and are within 2000 psi [14 MPa] of the required tensile strength, within 1000 psi [7 MPa] of the required yield strength, or within two percentage units of the required elongation, a retest shall be permitted on two random specimens for each original tension specimen failure from the lot. All retest specimens shall meet the requirements of this specification.

17.2 If a bend test fails for reasons other than mechanical reasons or flaws in the specimen as described in 17.5.2 and 17.5.3, a retest shall be permitted on two random specimens from the same lot. Both retest specimens shall meet the requirements of this specification. The retest shall be performed on test specimens that are at air temperature but not less than 60°F [16°C].

17.3 If a weight [mass] test fails for reasons other than flaws in the specimen as described in 17.5.3, a retest shall be

**TABLE 4 Bend Test Requirements**

Bar Designation No.	Pin Diameter for Bend Test <sup>1</sup>		
	Grade 40 [280]	Grade 60 [420]	Grade 75 [520]
3, 4, 5 [10, 13, 16]	$3\frac{1}{2} d^B$	$3\frac{1}{2} d$	...
6 [19]	$5d$	$5d$	$5d$
7, 8 [22, 25]	...	$5d$	$5d$
9, 10, 11 [29, 32, 36]	...	$7d$	$7d$
14, 18 [43, 57] (90°)	...	$9d$	$9d$

<sup>1</sup> Test bends 180° unless noted otherwise.

<sup>B</sup>  $d$  = nominal diameter of specimen.

permitted on two random specimens from the same lot. Both retest specimens shall meet the requirements of this specification.

17.4 If a corrosion resistance test fails for reasons other than flaws as described in 17.5.3, a retest shall be permitted on two random specimens from the same lot. Both retest specimens shall meet the requirements of this specification.

17.5 If the original test or any of the random retests fails because of any reasons listed in 17.5.1, 17.5.2, or 17.5.3, the test shall be considered an invalid test:

17.5.1 The elongation property of any tension test specimen is less than that specified, and any part of the fracture is outside the middle half of the gage length, as indicated by scribe marks on the specimen before testing,

**NOTE 6**—Marking specimens with multiple scribe or punch marks can reduce the occurrence of fracture outside or near these marks and the need for declaring the test invalid.

17.5.2 Mechanical reasons such as failure of testing equipment or improper specimen preparation,

17.5.3 Flaws are detected in a test specimen, either before or during the performance of the test.

17.6 The original results from sections 17.5.1, 17.5.2, or 17.5.3 shall be discarded and the test shall be repeated on a new specimen from the same lot.

## 18. Test Specimens

18.1 Tension test specimens shall be the full section of the bar as rolled. The unit stress shall be based on the nominal bar area.

18.2 The bend test specimens shall be the full section of the bar rolled.

## 19. Report

19.1 The following information shall be reported on a per heat or per lot basis as is appropriate.

19.1.1 Stainless steel type and name,

19.1.2 Chemical composition and product check (if appropriate),

19.1.3 Heat treat condition,

19.1.4 Descaling method and finish,

19.1.5 Bar size,

19.1.6 Tensile properties,

19.1.7 Bend test (if required),

19.1.8 Hardness (if appropriate),

19.1.9 Corrosion test (if appropriate), and

19.1.10 Magnetic permeability (if appropriate).

19.2 A Material Test Report, Certificate of Inspection, or similar document printed from or used in electronic form from an electronic data interchange (EDI) transmission shall be regarded as having the same validity as a counterpart printed in the certifier's facility. The content of the EDI transmitted document must meet the requirements of the invoked ASTM standard(s) and conform to any EDI agreement between the purchaser and the supplier. Notwithstanding the absence of a signature, the organization submitting the EDI transmission is responsible for the content of the report.

**NOTE 7**—The industry definition invoked here is: EDI is the computer to computer exchange of business information in a standard format such as ANSI ASC X12.

## 20. Inspection

20.1 The inspector representing the purchaser shall have free entry at all times while work on the contract of the purchaser is being performed to all parts of the manufacturer's works that concern the manufacture of the material ordered. The manufacturer shall afford the inspector access to all reasonable facilities to satisfy him or her that the material is being furnished in accordance with this specification. All tests (except product analysis) and inspection shall be made at the place of manufacture prior to shipment, unless otherwise specified, and shall be conducted so as not to interfere unnecessarily with the operation of the works.

20.2 *For Government Procurement Only*—Except as otherwise specified in the contract, the contractor is responsible for the performance of all inspection and test requirements specified herein. The contractor shall be permitted to use ones own or any other suitable facilities for the performance of the inspection and test requirements specified herein, unless disapproved by the purchaser at the time of purchase. The purchaser shall have the right to perform any of the inspections and tests at the same frequency as set forth in this specification where such inspections are deemed necessary to assure that the material conforms to the prescribed requirements.

## 21. Rejection

21.1 Unless otherwise specified, any rejection based on tests made in accordance with 6.3 shall be reported to the manufacturer within five days from the receipt of samples by the purchaser.

21.2 Material that shows injurious defects subsequent to its acceptance at the manufacturer's works will be rejected and the manufacturer shall be notified.

## 22. Rehearing

22.1 Samples tested in accordance with 6.3 that represent rejected material shall be preserved for two weeks from the date rejection is reported to the manufacturer. In case of dissatisfaction with the results of the tests, the manufacturer shall have the right to make claim for a rehearing within that time.

## 23. Marking

23.1 When loaded for mill shipment, bars shall be properly separated and tagged with the manufacturer's heat or test identification number.

23.2 Each manufacturer shall identify the symbols of his or her marking system.

23.3 All bars produced to this specification shall be identified by distinguishing marks legibly rolled onto the surface of one side of the bar to denote in the following order:

23.3.1 *Point of Origin*—Letter or symbol established as the manufacturer's mill designation.

23.3.2 *Size Designation*—Arabic number corresponding to bar designation number of Table 1.

23.4 In addition to the bar marks, the following information shall be tagged on each bundle:

- 23.4.1 Stainless-steel alloy, and
- 23.4.2 Heat treat condition, and
- 23.4.3 Grade (corresponding to minimum yield strength level), and
- 23.4.4 Meets Supplementary Requirement S1, if appropriate.
- 23.5 For plain rounds, no rolled on symbols are required and all of the above information shall be tagged.

#### **24. Packaging and Package Marking**

- 24.1 Packing, marking, and loading for shipment shall be in accordance with Practices A700.

24.2 When specified in the contract or order, and for direct procurement by or direct shipment to the U.S. Government, marking for shipment, in addition to requirements specified in the contract or order, shall be in accordance with MIL-STD-129 for military agencies and with Fed. Std. No. 123 for civil agencies.

#### **25. Keywords**

- 25.1 concrete reinforcement; corrosion resistance; deformations (protrusions); magnetic properties; stainless steel bars

### **SUPPLEMENTARY REQUIREMENTS**

The following supplementary requirement shall apply only when specified in the purchase order or contract.

#### **S1. Magnetic Permeability Testing**

- S1.1 (See 13.1.) When material of a low permeability is desired, the purchaser shall specify that the material be tested

to Test Methods A342/A342M. The specific limits of magnetic permeability shall be a matter of agreement between the manufacturer and the purchaser.

### **ANNEXES**

#### **(Mandatory Information)**

#### **A1. EVALUATION OF CORROSION RESISTANCE**

A1.1 The corrosion resistance of the reinforcing steel, including the method of removing the mill scale, shall be evaluated based on either A1.2 or A1.3.

A1.2 Using a macrocell test of bare bars in a simulated concrete pore 15 % sodium chloride solution over a 15-week period, as specified in Annex A2, the average corrosion rate for a minimum of five specimens shall at no time during the test

exceed 0.25  $\mu\text{m}/\text{year}$ , with no single specimen exceeding a corrosion rate of 0.50  $\mu\text{m}/\text{year}$ .

A1.3 Using a cracked beam test over a 75-week period, as specified in Annex A3, the average corrosion rate for a minimum of five specimens shall at no time during the test exceed 0.20  $\mu\text{m}/\text{year}$ , with no single specimen exceeding a corrosion rate of 0.50  $\mu\text{m}/\text{year}$ .

#### **A2. RAPID MACROCELL TEST**

##### **A2.1 Scope**

A2.1.1 This test method describes procedures to measure the corrosion rate and corrosion potential of concrete reinforcing steel using the rapid macrocell test.

##### **A2.2 Test Equipment and Materials**

A2.2.1 *Plastic Containers*—Two 4.5-quart [4.5-L] plastic containers per test, approximately 7 in. [180 mm] in diameter by 7.5 in. [190 mm] in depth for each test setup.

A2.2.2 *Voltmeter*—High impedance voltmeter (at least one Mohm) capable of measuring 0.001 mV.

A2.2.3 *Reference Electrode*—A saturated calomel electrode, as defined in Practices G15.

A2.2.4 *Resistor*—10-ohm ( $\pm 0.3$  ohm) electrical resistor.

A2.2.5 *Terminal Box*—Terminal boxes are used to make the electrical connections between the test specimens. Each terminal box consists of a project box with a minimum of 6 pairs of binding posts (identified here as red and black). A 10-ohm resistor connects each pair of binding posts in the terminal boxes.

A2.2.6 *Wire*—16-gauge [1.5 mm<sup>2</sup>] insulated copper wire is used to make the electrical connections to the bars.

A2.2.7 *Epoxy Coating*—A two-part epoxy coating (such as used to as patching material for epoxy-coated bars) shall be used to cover the electrical connections. It shall be applied in accordance with manufacturer's recommendations.

**A2.2.8 Concrete Pore Solution**—Simulated concrete pore solution is prepared as follows: One litre of pore solution contains 974.8 g of distilled water, 18.81 g of potassium hydroxide (KOH), 17.87 g of sodium hydroxide (NaOH).

**A2.2.9 Sodium Chloride Solution**—The sodium chloride solution is prepared by adding 172.1 g of sodium chloride (NaCl) to one liter of simulated concrete pore solution to obtain a 15 % (6.04 molal ion) concentration solution.

**A2.2.10 Salt Bridges**—Salt bridges provide an ionic path between the solutions surrounding the cathode and the anode. The salt bridges shall be prepared as follows: A salt bridge consists of a flexible latex tube with an inner diameter of  $\frac{3}{8}$  in. (9.5 mm), filled with a gel. The gel is made using 4.5 g of agar, 30 g of potassium chloride (KCl), and 100 g of distilled water, enough to produce 4 salt bridges, each with a length of 2 ft [0.6 m]. Salt bridges are prepared by mixing the constituents and heating them over a burner or hotplate for about 1 min or until the solution starts to thicken. The gel is poured into the latex tubes using a funnel. The salt bridges are then placed in boiling water for one hour, keeping the ends of the tubes out of the water. After boiling, the salt bridges are allowed to cool until firm. To provide an adequate ionic path, the gel in the salt bridge must be continuous, without any air bubbles.

**A2.2.11 Air Scrubber**—Air is bubbled into the simulated concrete pore solution surrounding the cathode in the macrocells to provide enough oxygen for the cathodic reaction. An air scrubber is used to minimize carbonation of the pore solution by eliminating the carbon dioxide from the air. To prepare the air scrubber, a 5-gal [20-L] container is partially filled with a 1-M sodium hydroxide solution. Compressed air is channeled into the scrubber and out to the specimens through latex tubing. The procedure for preparing the air scrubber is as follows:

- (1) Two barbed fittings are inserted on the top of the container.
- (2) A 5 ft [1.5 m] piece of plastic tubing is cut. On one end of the tubing, 4 ft [1.2 m] is perforated with a knife, making (typically, hundreds of) holes to allow the air to produce small bubbles. The end of the tubing closest to the holes is sealed with a clamp.
- (3) The tubing end with the holes is coiled at the bottom of the container and trap rock is used to hold down the tubing. The other end of the tubing is connected to the inside part of one of the barbed fittings.
- (4) The other side of the barbed fitting is connected to a plastic tube, which is connected to the compressed air outlet.
- (5) Another piece of plastic tubing is connected to the outside of the other barbed fitting. The air is distributed to the solution surrounding the cathodes using 1 ft [0.3 m] lengths of latex tubing and polypropylene T-shaped connectors.
- (6) Screw clamps are placed to regulate the amount of air bubbled into each container.
- (7) Distilled water is periodically added to the container to replace water that is lost due to evaporation. NaOH is added, if necessary, to maintain the pH of the solution above 12.5.

## A2.3 Test Specimen Preparation

**A2.3.1 Reinforcing bars** used in this test should be prepared in the same manner, including surface treatment, as it will be offered to the purchaser.

**A2.3.2** An individual specimen (bare bar) shall consist of a 5 in. [125 mm] long, No. 5 [No. 16] reinforcing bar. Sharp edges on the bar ends shall be removed with a grinder, and the bar shall be drilled and tapped at one end to receive a  $\frac{3}{8}$ -in. [10-mm] long 10-24 threaded stainless steel bolt, which is used to connect the copper wire to the bar. The bar shall be then cleaned with acetone to remove oil or dust from the bar surface. A 16-gauge [1.5 mm<sup>2</sup>] insulated copper wire shall be attached to the top of the bar. The connection shall be covered with two layers of epoxy to prevent crevice corrosion. Each layer should be cured for a minimum of four hours.

## A2.4 Test Method

**A2.4.1** The macrocell test, shown in Fig. A2.1, consists of an anode and a cathode. The cathode shall consist of two bare bars in simulated concrete pore solution. The anode shall consist of one bare bar in simulated concrete pore solution with 15 % NaCl (6.04 molal ion concentration). The solutions shall be changed every five weeks. The test shall be run for 15 weeks at room temperature, 68 to 76°F [20 to 24°C].

**A2.4.2** At the anode, simulated concrete pore solution with NaCl shall be placed in a container to a depth of 3 in. [75 mm]. One bar shall be placed in the center of the container, resting on the bottom of the container. The top of the bar shall be supported with the container lid, which shall be placed just above the water level. The free end of a copper wire shall be attached to the specimen and to a black binding post in a terminal box. Another container shall be filled with simulated concrete pore solution without NaCl to a depth of 3 in. [75 mm]. Two bars shall be placed in the container to act as the cathode. The bars shall be fixed in place with the lid. The free ends of copper wires shall be attached to the specimens and to a third wire that has its other end attached to a red binding post in a terminal box. Air, scrubbed to remove carbon dioxide (CO<sub>2</sub>), shall be bubbled into the solution surrounding the cathode specimens to provide enough oxygen for the cathodic reaction. A salt bridge shall connect the solutions surrounding the cathode and the anode.

**A2.4.3** The voltage drop shall be measured across the 10-ohm resistor that completes the macrocell circuit by connecting the black binding post to the red binding post in the terminal box. The negative terminal of the voltmeter shall be connected to the black binding post and the positive terminal of the voltmeter shall be connected to the red binding post. After the voltage drop has been measured, the anodes shall be disconnected from the terminal box. Two hours after being disconnected, the corrosion potentials of the anode and the cathode shall be measured by placing the saturated calomel electrode in the solution surrounding the bar and connecting it to the positive terminal on the voltmeter and the bar (cathode or anode) to the negative terminal of the voltmeter. Readings shall be taken once a day for the first seven days of the test and weekly, thereafter.

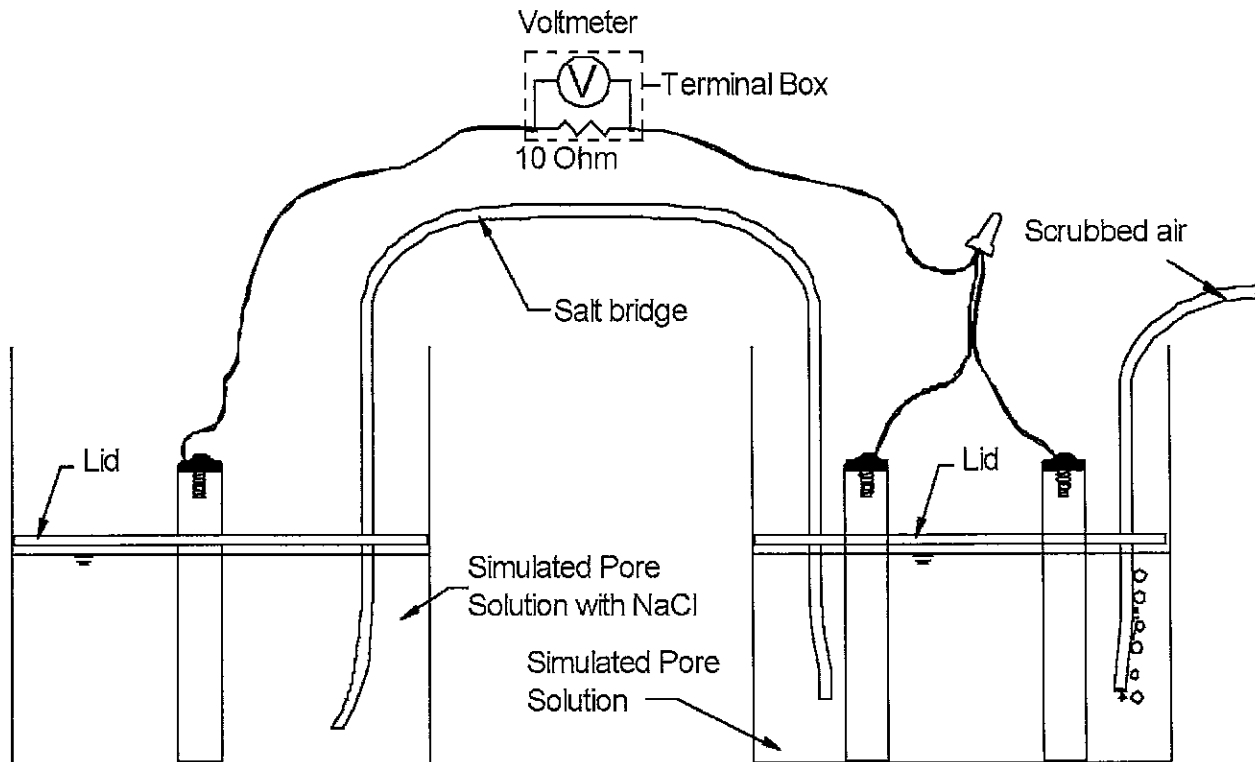


FIG. A2.1 Schematic of Macrocell Test with Bare Bars

A2.4.4 The voltage drop obtained from the macrocell readings shall be converted to a corrosion rate (in  $\mu\text{m}/\text{year}$ ) using the following equation:

$$\text{Rate} = 11.6 \cdot i_c = \frac{11600 \cdot V}{A \cdot R} \quad (\text{A2.1})$$

where:

- $i_c$  = corrosion current density ( $\mu\text{A}/\text{cm}^2$ ),
- $V$  = voltage drop across resistor (mV),
- $R$  = resistance of the resistor (ohm), and

$A$  = area of exposed metal at the anode bar ( $\text{cm}^2$ ).

### A2.5 Report

A2.5.1 The following information shall be reported for each test setup:

A2.5.2 Type and source of the reinforcing bars, and description of the surface preparation.

A2.5.3 Individual readings of voltage drop and the calculated value of corrosion rate.

A2.5.4 Individual readings of corrosion potential for anode and cathode with respect to the saturated calomel electrode.

## A3. CRACKED BEAM TEST

### A3.1 Scope

A3.1.1 This test method describes procedures to measure the corrosion rate and corrosion potential of reinforcing bars in concrete using the cracked beam test.

### A3.2 Test Equipment and Materials

A3.2.1 *Voltmeter*—High impedance voltmeter (at least one Mohm) capable of measuring 0.001 mV.

A3.2.2 *Reference Electrodes*—Saturated calomel electrode and copper-copper sulfate electrode, as defined in Practices G15.

A3.2.3 *Resistor*—10-ohm ( $\pm 0.3$  ohm) electrical resistor.

A3.2.4 *Terminal Box*—Terminal boxes are used to make the electrical connections between the test specimens. Each terminal box consists of a project box with a minimum of 6 pairs of

binding posts (identified here as red and black). A 10-ohm resistor connects each pair of binding posts in the terminal boxes.

A3.2.5 *Wire*—16-gauge [ $1.5 \text{ mm}^2$ ] insulated copper wire is used to make the electrical connections to the bars.

A3.2.6 *Epoxy Sealer*—A two-part epoxy sealer shall be used to cover the sides of the specimens and the electrical connections. It shall be applied in accordance with manufacturer's recommendations.<sup>4</sup>

<sup>4</sup> Ceilgard 615 made by Ceilcote and Sewer Guard HBS 100 Epoxy Liner made by BASF Construction Chemicals, Inc., have been found to be suitable for this purpose. If you are aware of alternative suppliers, please provide this information to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee,<sup>1</sup> which you may attend.



A3.2.7 *Sodium Chloride Solution*—The 15 % sodium chloride solution is prepared by adding 150 g of NaCl to 850 g of distilled or deionized water.

**A3.3 Test Specimen Preparation**

A3.3.1 The procedures for preparing cracked beam specimens (see A3.4.1 and Fig. A3.1) shall be as follows:

A3.3.2 No. 5 [No. 16] bars shall be cut to a length of 12 in. [300 mm].

A3.3.3 Sharp edges on the ends of the bars shall be removed with a grinder.

A3.3.4 The ends of the bars shall be drilled and tapped to receive a 3/8-in. [10-mm] long 10-24 threaded stainless steel bolt. The bolt is used to hold the bars in place during casting and to make an electrical connection during the testing period.

A3.3.5 The bars shall be cleaned with acetone to remove dust and oil.

A3.3.6 Mineral oil shall be applied to the forms prior to placing the bars in the forms.

A3.3.7 A 12-mil [0.30-mm] thick, 6-in. [150-mm] long stainless steel shim shall be fixed on to the bottom part of the form so that the shim is located underneath and parallel to the top bar.

A3.3.8 The bars shall be bolted into the forms. The specimens are cast upside down to allow for the integral concrete dam to be cast at the same time.

A3.3.9 The concrete in the test specimens shall be proportioned on a cubic yard [cubic metres] basis with the following constituents: 598 lb [355 kg] of Type I portland cement, 270 lb [160 kg] of water, normalweight fine aggregate constituting 32.5 % of the total concrete volume, normalweight 3/4 in. [19 mm] nominal maximum size coarse aggregate constituting 34 % of the total concrete volume, and 6 ± 1 % air content by volume. The concrete shall be cast and cured using the following procedure:

(1) The concrete shall be mixed according to Practice C192/C192M.

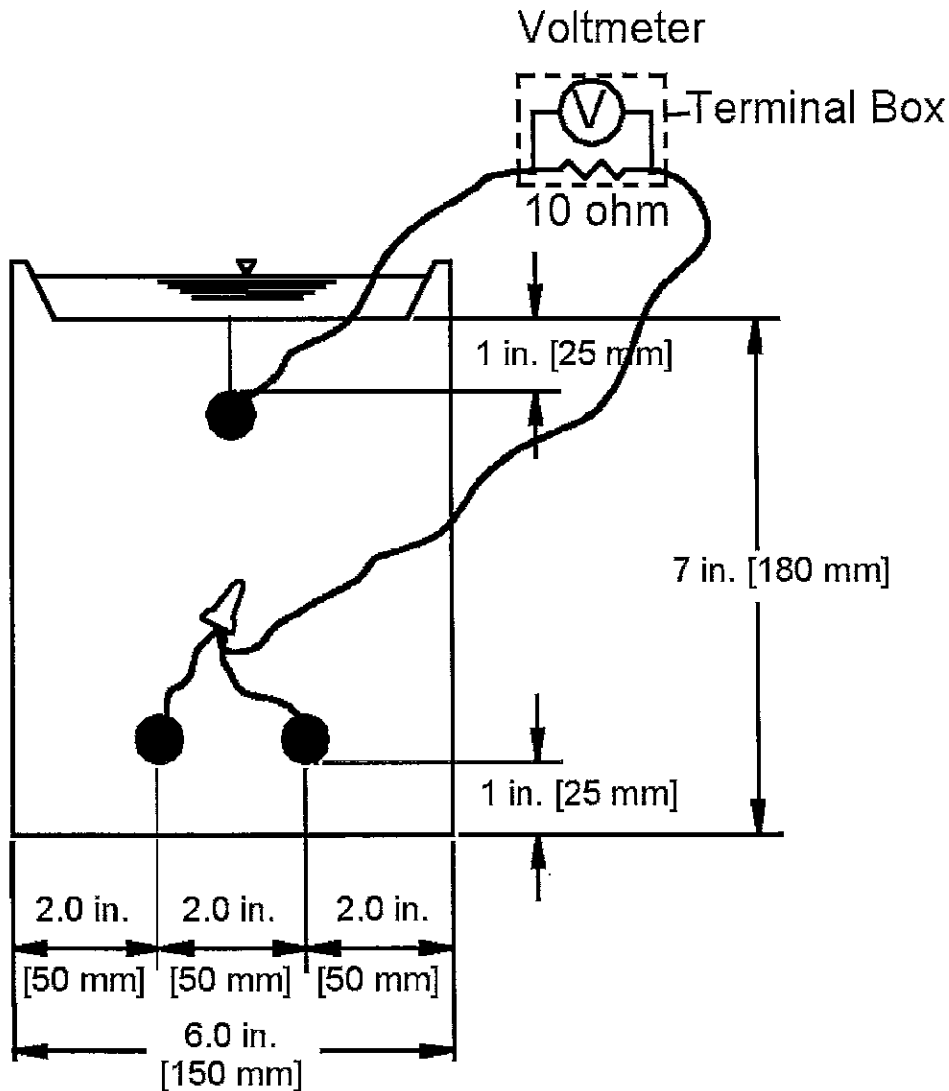


FIG. A3.1 Side View of Cracked Beam Specimen

(2) The specimens shall be cast in an inverted position in two layers. Each layer shall be vibrated for 30 s on a vibrating table with an amplitude of 0.0006 in. [0.15 mm] and a frequency of 60 hz.

(3) After the second layer is vibrated, the surface of the specimen shall be finished using a wooden float.

(4) The specimens shall be cured in the forms for 8 to 24 h.

(5) After the initial curing period, the specimens shall be removed from the molds, and the stainless steel shims shall be removed. The specimens shall be placed in a plastic bag with distilled water until 72 h after casting and then removed from the bags and cured in air for 25 days.

A3.3.10 Several days before the testing period starts, 16-gauge [1.5 mm<sup>2</sup>] insulated copper wire shall be attached to the bars in the specimens using  $\frac{3}{8}$ -in. [10-mm] long 10-24 threaded stainless steel bolts. The vertical sides of the specimens shall then be covered with two layers of the epoxy sealer. The electrical connections on the sides shall also be thoroughly coated to prevent crevice corrosion or galvanic corrosion from occurring.

A3.3.11 The top of the specimens shall be lightly sanded with 150-grit sand paper.

A3.3.12 The specimens shall be supported on two pieces of wood, at least 2 in. [50 mm] thick, to allow air to flow under the specimens.

A3.3.13 The top layer of steel shall then be connected to a red binding post on the terminal box, while the bottom layer of steel is connected to a black binding post.

### A3.4 Test Method

A3.4.1 The cracked beam specimen (see Fig. A3.1) shall be 6 in. [150 mm] wide, 7 in. [175 mm] high, and 12 in. [300 mm] long  $\pm 0.25$  in. [6 mm] for any dimension. It shall contain one No. 5 [No. 16] bar in the top mat electrically connected across a 10-ohm ( $\pm 0.3$  ohm) resistor to two No. 5 [No. 16] bars in the bottom mat. A crack shall be simulated in the concrete parallel to and above the top bar using a  $0.012 \pm 0.001$  in. [ $0.30 \pm 0.02$  mm] thick,  $6 \pm 0.25$  in. [ $150 \pm 6$  mm] long stainless steel shim, cast into the concrete and removed 20 to 28 h after casting. The concrete cover to the top and bottom steel shall be  $1 \pm 0.04$  in. [ $25 \pm 1$  mm]

A3.4.2 The test procedure for the cracked beam specimens shall proceed as follows beginning 28 days after casting.

(1) On the first day of a cycle, the specimens shall be ponded with a 15 % sodium chloride solution at room temperature, 68 to 76°F [20 to 24°C]. This solution shall be left on the specimen for 4 days  $\pm 3$  h. Evaporation will be limited if the specimens are covered with plastic.

(2) On the fourth day of a cycle, the voltage drop across the 10-ohm resistor connecting the two mats of steel shall be recorded for each specimen. The 10-ohm resistor completes the macrocell circuit by connecting the black binding post to the red binding post in the terminal box. The negative terminal of the voltmeter shall be connected to the black binding post and the positive terminal of the voltmeter shall be connected to the red binding post.

(3) The voltage drop obtained from the macrocell readings shall be converted to a corrosion rate (in  $\mu\text{m}/\text{year}$ ) using Eq A2.1.

(4) After the voltage drop has been measured, the circuit shall then be disconnected. Two hours after disconnecting the specimens, the solution on top of the specimens shall be removed with a vacuum cleaner, and the corrosion potentials with respect to a copper-copper sulfate electrode (CSE) of the top and bottom mats of steel recorded.

(5) After the readings have been taken, a heat tent shall be placed over the specimens to maintain a temperature of  $100 \pm 3^\circ\text{F}$  [ $38 \pm 2^\circ\text{C}$ ]. The specimens shall remain under the heat tent for 3 days  $\pm 3$  h.

(6) After 3 days, the tent shall be removed and the specimens shall again be ponded with a 15 % sodium chloride solution and the cycle started again.

(7) The wet-dry cycle shall be repeated for 12 weeks. The specimens shall then be subjected to 12 weeks of continuous ponding. During this period the solution shall not be removed and the specimens shall not be placed under the heat tents. The solution depth shall be maintained by adding additional sodium chloride solution. The voltage drop across the 10-ohm resistor shall be taken once a week as described in A3.4.2(2).

(8) After 12 weeks of continuous ponding, the drying and ponding cycle shall be repeated for 12 weeks, followed by 12 weeks of continuous ponding. The 24-week cycle shall be repeated to complete 60 weeks of testing.

NOTE A3.1—Because the specimens are ponded, the corrosion potential during this period should be taken with respect to a saturated calomel reference electrode (SCE) instead of a CSE, since the SCE is more convenient when the electrode has to be immersed in solution. Readings taken with the SCE are about 0.075 V more positive than those taken with the CSE.

NOTE A3.2—It is common practice to continue the test for a total of 96 weeks.

### A3.5 Report

A3.5.1 Type and source of reinforcing bars, and description of surface preparation.

A3.5.2 Individual readings of voltage drop and calculated value of corrosion rate.

A3.5.3 Individual readings of corrosion potential for anode and cathode with respect to the saturated calomel electrode.

SUMMARY OF CHANGES

Committee A01 has identified the location of selected changes to this standard since the last issue (A995/A995M – 09) that may impact the use of this standard. (Approved Oct. 1, 2009.)

(1) Revised 2.1 and 6.1.

(2) Revised Table 2.

Committee A01 has identified the location of selected changes to this standard since the last issue (A955/A955M – 07a) that may impact the use of this standard. (Approved May 1, 2009.)

(1) Deleted Table Footnote A under Table 1 and relabeled subsequent footnotes.

(2) Revised 9.2 and Table 3.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website ([www.astm.org](http://www.astm.org)).*